



# ELEVATION VIEW

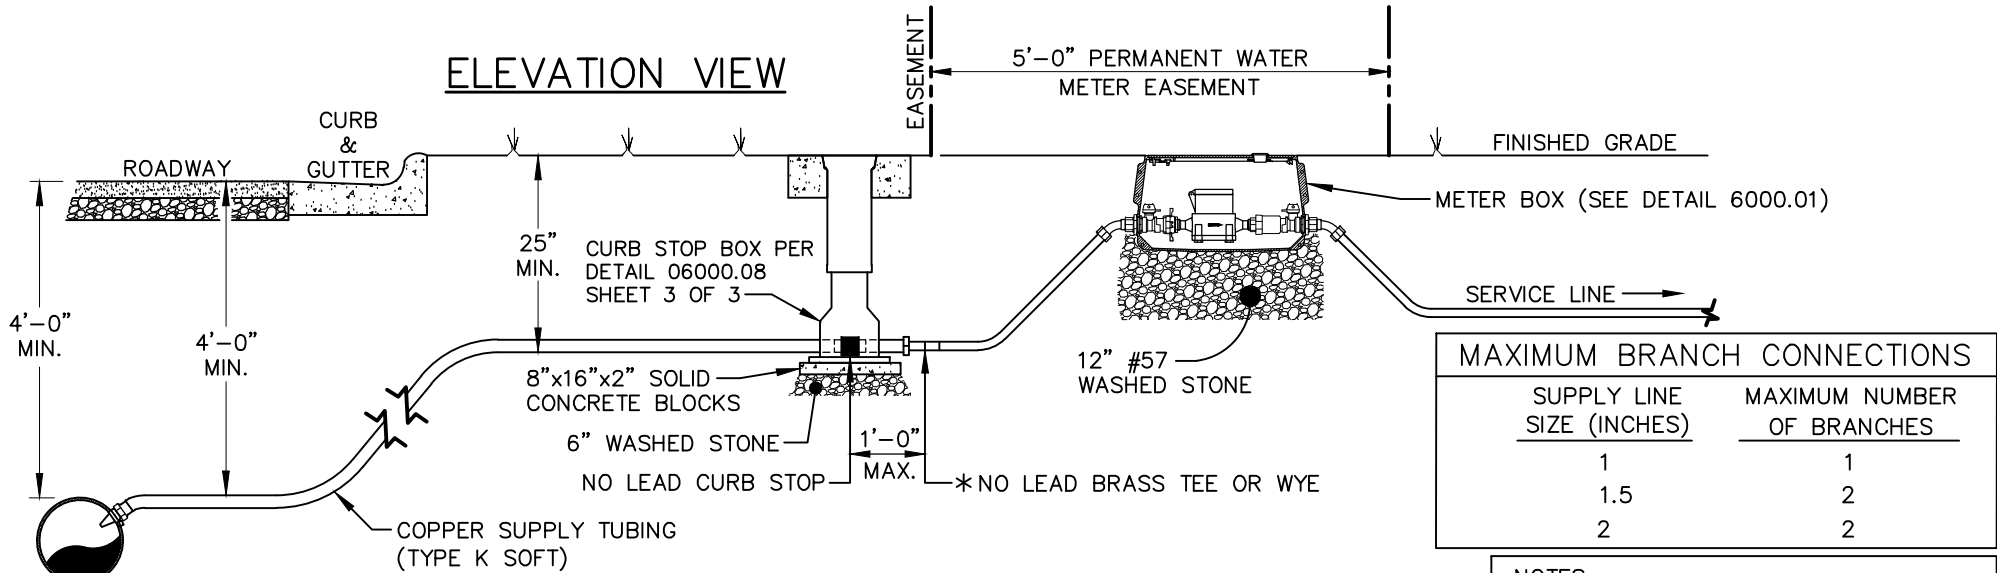

MAXIMUM BRANCH CONNECTIONS	
SUPPLY LINE SIZE (INCHES)	MAXIMUM NUMBER OF BRANCHES
1	1
1.5	2
2	2

- NOTES:**
1. THERE SHALL BE NO MULTIPLE CONNECTIONS FROM EXISTING 3/4 INCH SERVICE LINES.
  2. METER BOXES SHALL NOT BE LOCATED IN AREAS SUBJECT TO VEHICULAR TRAFFIC.
  3. NO LEAD CURB STOP SHALL BE CENTERED ON MULTIPLE BRANCH SERVICE.
  4. ALL BRASS COMPONENTS SHALL BE 'NO LEAD' BRASS MEETING UNS C89833 AS PER ASTM B584.
  5. MARKING TAPE SHALL BE INSTALLED FOR ALL SERVICE CONNECTIONS FROM THE MAIN LINE TO THE METER FOR ALL NEW CONSTRUCTION OR RETROFIT INSTALLATIONS USING OPEN TRENCH METHODS.
  6. MULTIPLE BRANCH SERVICES ARE ALLOWED FOR RESIDENTIAL APPLICATIONS ONLY ON A SINGLE PARCEL. GANG METER ASSEMBLIES ARE NOT ALLOWED. THIS DETAIL DOES NOT APPLY TO COMMERCIAL APPLICATIONS.

# PLAN VIEW

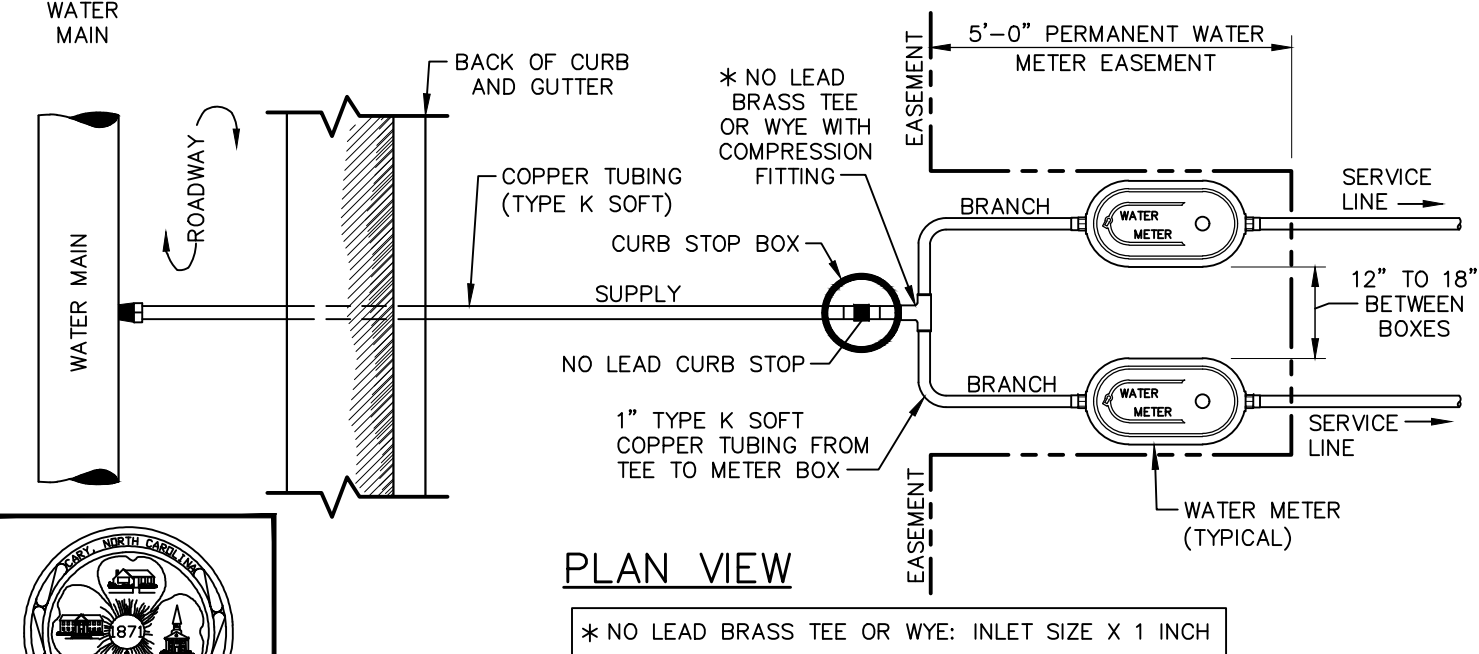

\* NO LEAD BRASS TEE OR WYE: INLET SIZE X 1 INCH



EFFECTIVE: 07/01/21

## STANDARD RESIDENTIAL MULTIPLE BRANCH SERVICES

DETAIL No.  
6000.06