



NOTES:

1. PUMP STATION PROPERTY OR EASEMENT SHALL BE 50' x 50' (ft.) MINIMUM.
2. EQUIPMENT LOCATIONS AND DIMENSIONS MAY VARY.
3. SITE WITHIN FENCE SHALL BE 5 INCH THICK REINFORCED CONCRETE SLAB OR 3 INCHES CRUSHED STONE OVER GEOTEXTILE FABRIC (SPECIFIED BY DIRECTOR OF UTILITIES).
4. THE PUMP STATION SITE LAYOUT AND DESIGN SHALL MEET ALL CARY SITE PLANNING AND DESIGN REQUIREMENTS.
5. PIGGING & BYPASS CONNECTION LOCATION WILL VARY.

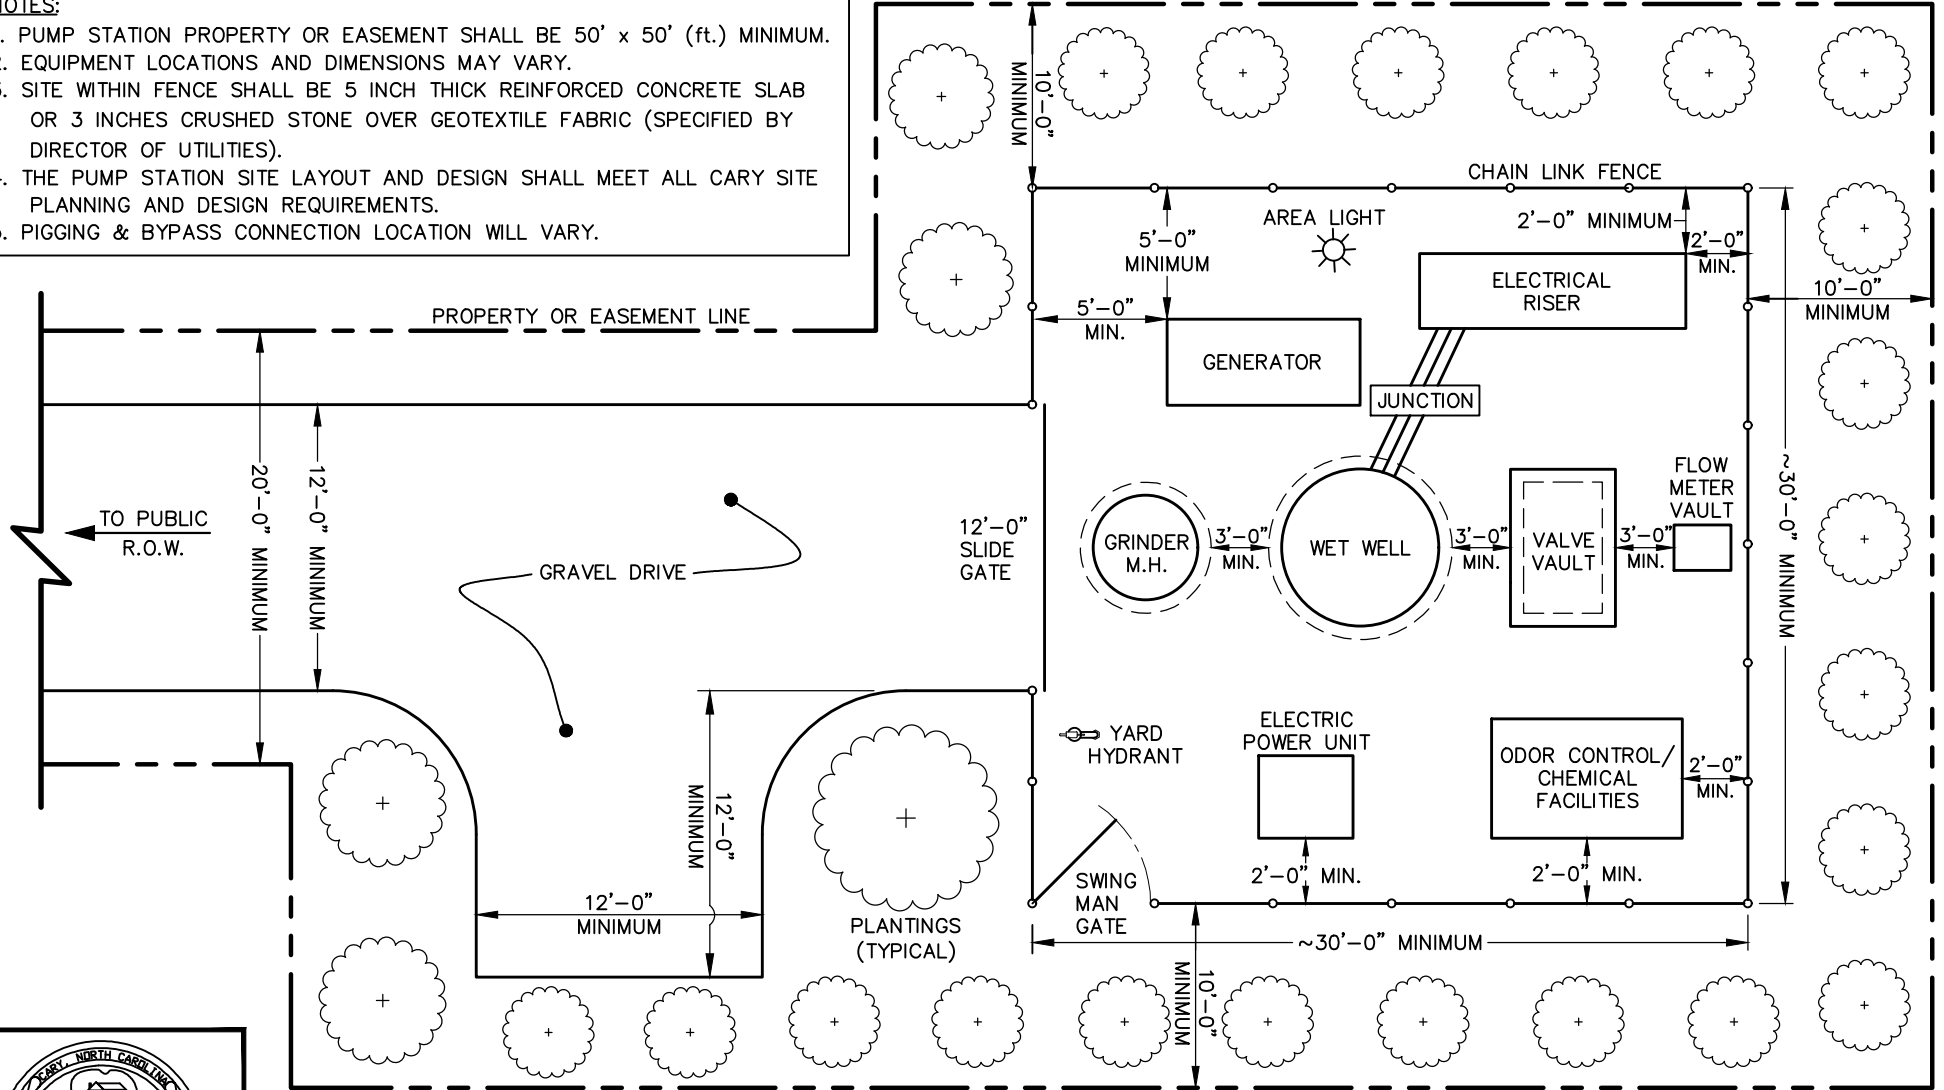

PUMP STATION SITE LAYOUT

DETAIL No.

7500.01

EFFECTIVE: 07/01/21