


- NOTES:**
1. SAMPLING STATIONS SHALL BE 30" BURY, WITH A 3/4" STRAIGHT SPIGOT AND SMOOTH BORE.
 2. ALL STATIONS SHALL BE ENCLOSED IN A LOCKABLE, NON-REMOVABLE, ALUMINUM-CAST HOUSING.
 3. A S.S. VENT TUBE WILL ENABLE EACH STATION TO BE PUMPED FREE OF STANDING WATER TO PREVENT FREEZING AND TO MINIMIZE BACTERIA GROWTH.
 4. PADLOCK PROVIDED BY CARY PUBLIC WORKS DEPARTMENT.
 5. ALL BRASS COMPONENTS SHALL BE 'NO LEAD' BRASS MEETING UNS C89833 AS PER ASTM B584.
 6. MANUFACTURER PER APPROVED PRODUCTS LIST.

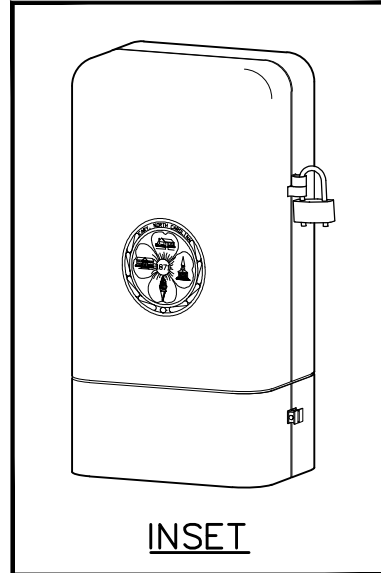

EFFECTIVE: 07/01/22

SAMPLING STATION

DETAIL No.
6000.32