


PLAN VIEW

SEE SHEET 2 OF 2 FOR SECTION "B-B"

NOTE:
ACCESS HATCH SHALL BE SIZED TO ALLOW FOR INSTALLATION AND REMOVAL OF GRINDER UNIT.

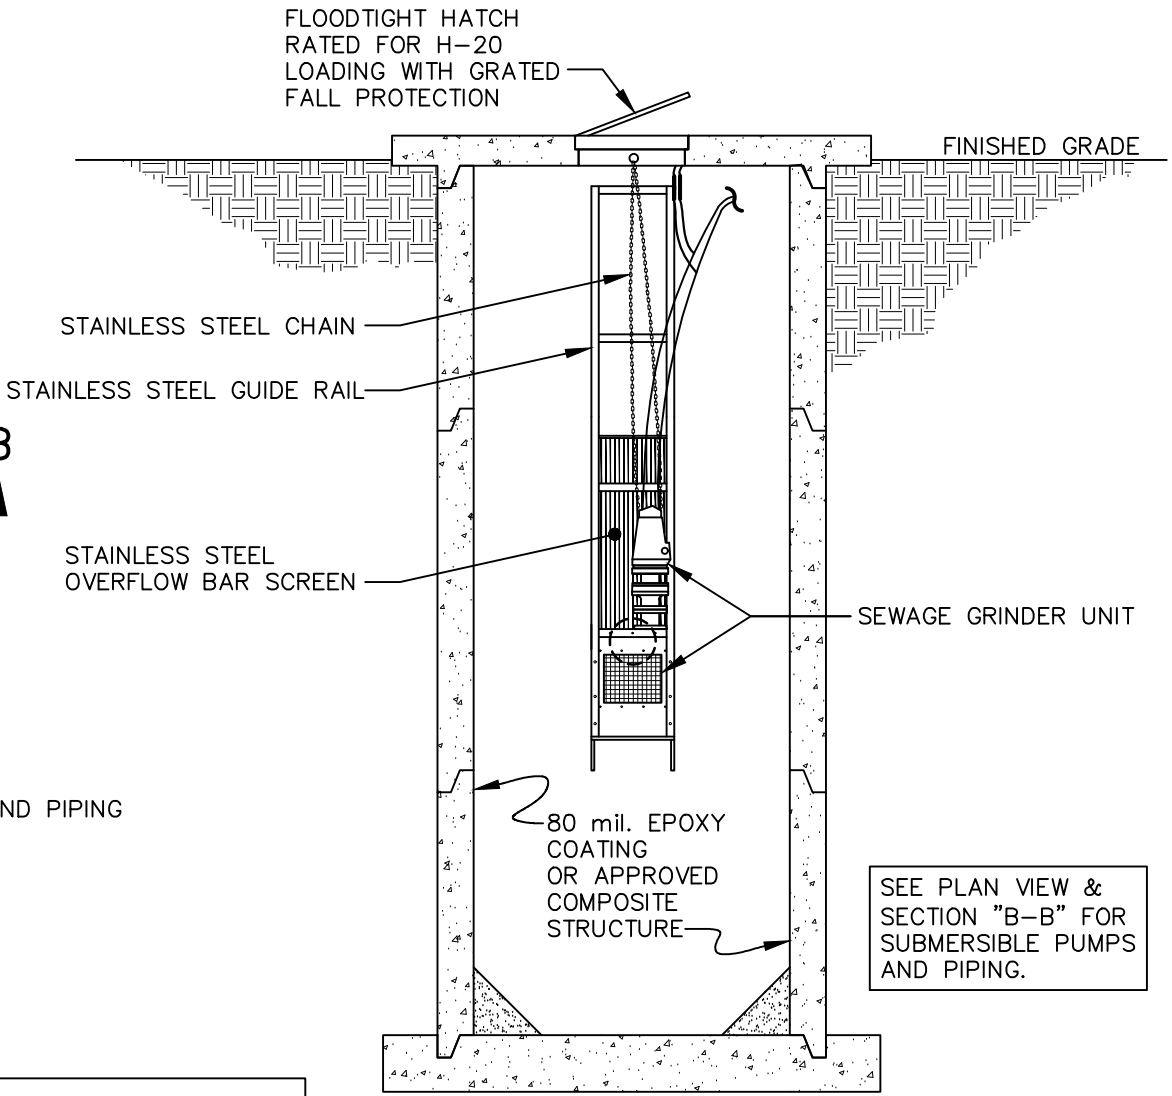

SEE PLAN VIEW & SECTION "B-B" FOR SUBMERSIBLE PUMPS AND PIPING.

SECTION "A-A"



EFFECTIVE: 07/01/22

SEWAGE GRINDER UNIT (WET WELL INSTALLATION)

DETAIL No.

7500.04
SHEET 1 OF 2