


THE EDGES OF THE DRAIN HOLE OR BORE MUST BE ROUNDED AND FINISHED SMOOTH AT THE FACE OF THE CURB.

FRONT VIEW

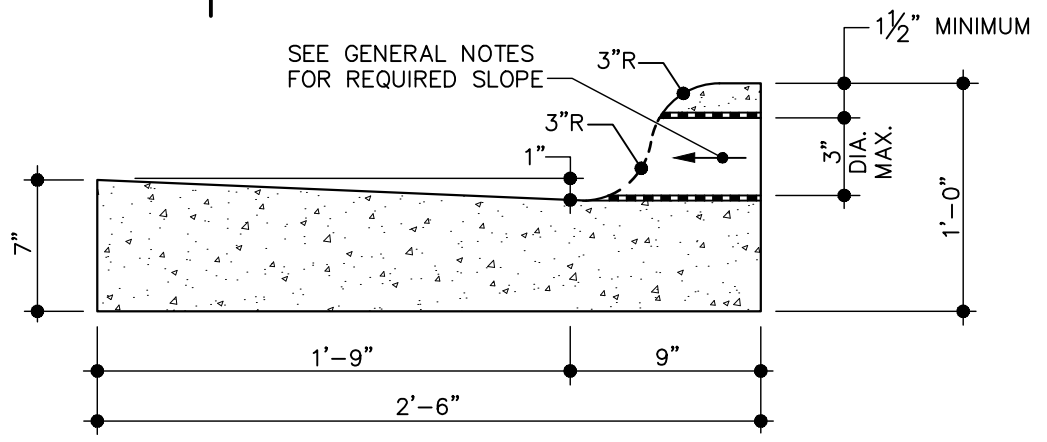

SECTION A-A

SEE GENERAL NOTES FOR REQUIRED SLOPE

- GENERAL NOTES:**
1. CURB DRAINS SHALL NOT BE CONSTRUCTED WITHIN 18 INCHES OF CONTRACTION OR EXPANSION JOINTS.
 2. OPENING GRADE MAY VARY BETWEEN A MAXIMUM SLOPE OF 1/2" PER FT. AND A MINIMUM OF 1/4" PER FT.
 3. MORE THAN ONE HOLE MAY BE INSTALLED PROVIDED THE HOLES ARE LOCATED WITH 18 INCHES MINIMUM SPACING.
 4. IN LIEU OF CUTTING THE CURB TO INSTALL A 3 INCH PIPE, A 4 INCH CONCRETE BORE MAY BE USED.
 - A) BORE OR REMOVE & REPOUR 5 FOOT SECTION OF CURB, NO CUTTING OUT TOP OF CURB.
 - B) MAY NEED PERMIT AND/OR ENCROACHMENT AGREEMENT FROM THE PUBLIC WORKS AND/OR TRANSPORTATION & FACILITIES DEPARTMENT'S.



EFFECTIVE:07/01/23

STANDARD CURB DRAIN

DETAIL No.

3100.11