


**NOTES:**

1. SEE SHEET 1 OF 3 OR 2 OF 3 FOR GENERAL TOP VIEW.
2. UL/FM AIR COMPRESSOR MAY ALSO BE FLOOR MOUNTED.

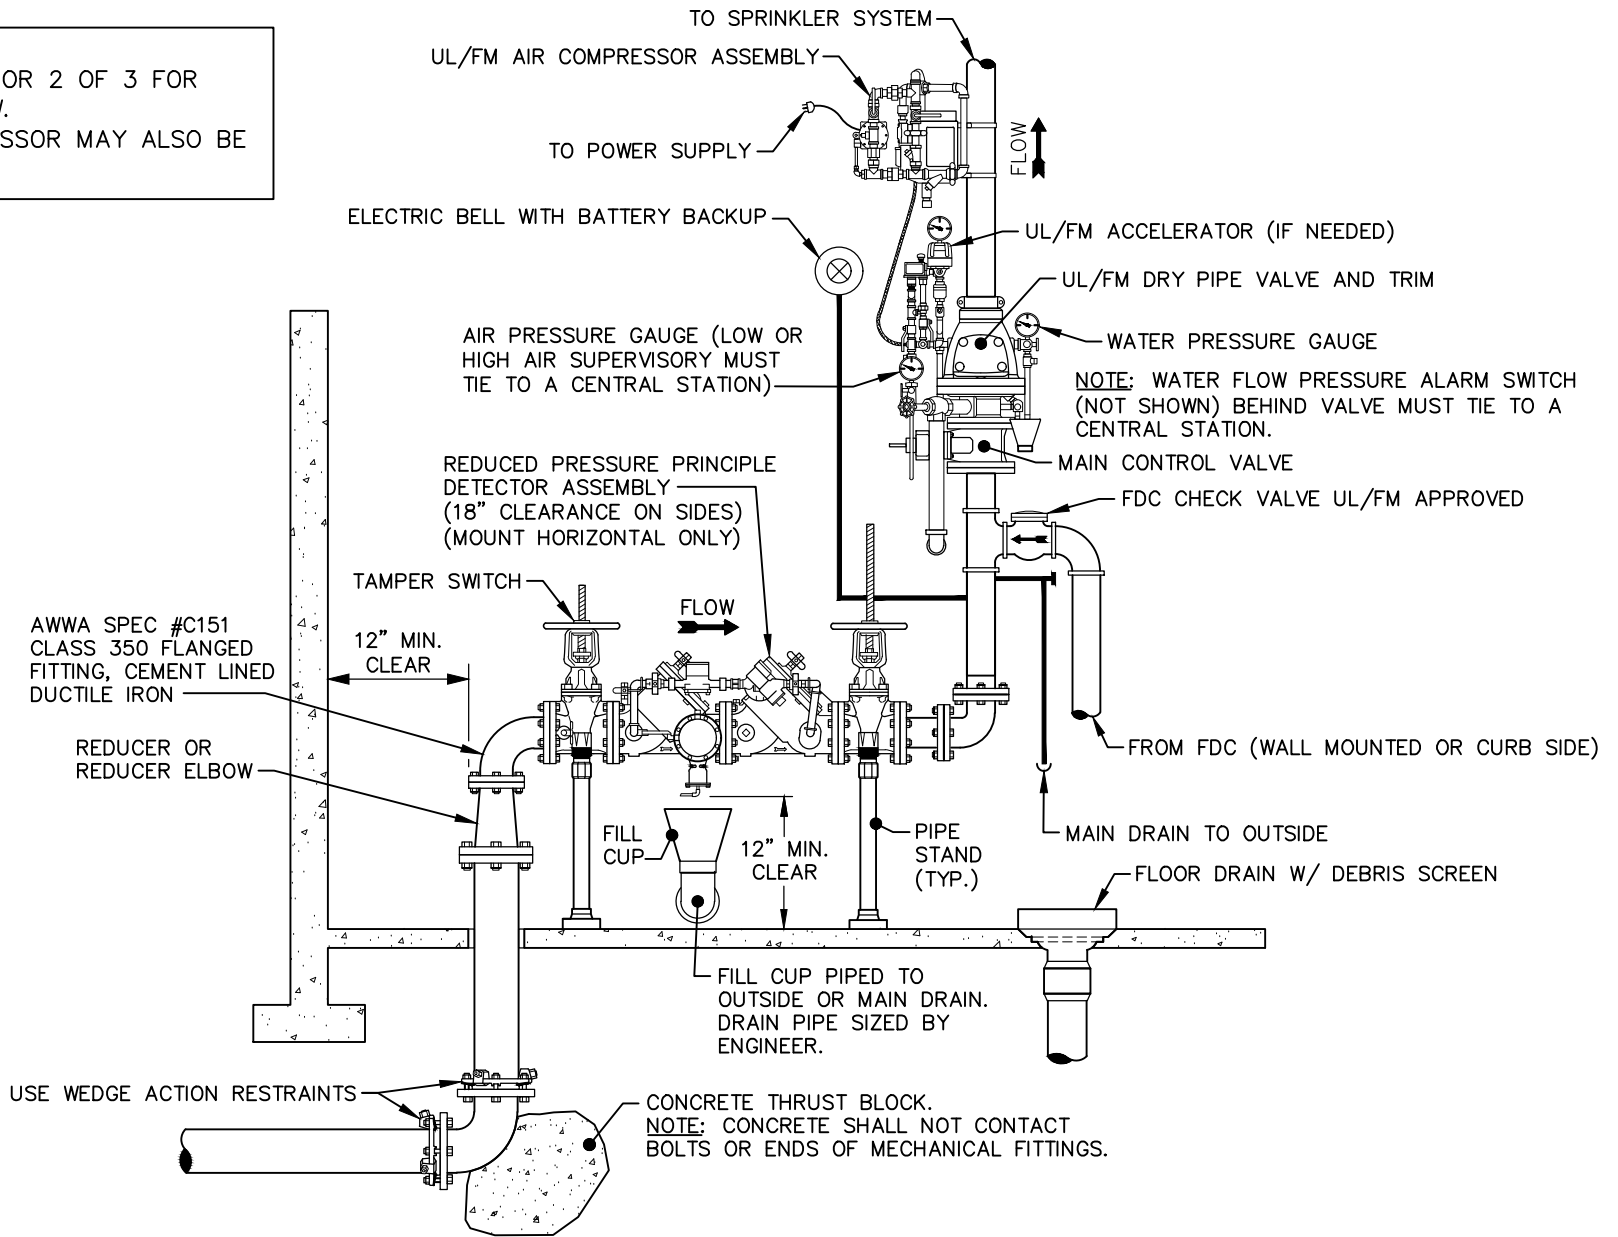

EFFECTIVE: 07/01/23

**DRY PIPE SPRINKLER RISER, NFPA 13**

DETAIL No.

6000.27

SHEET 3 OF 3