


TO SPRINKLER RISER
(SEE DETAIL 6000.27
FOR CONNECTION)

FLANGE JOINT
(TYPICAL)

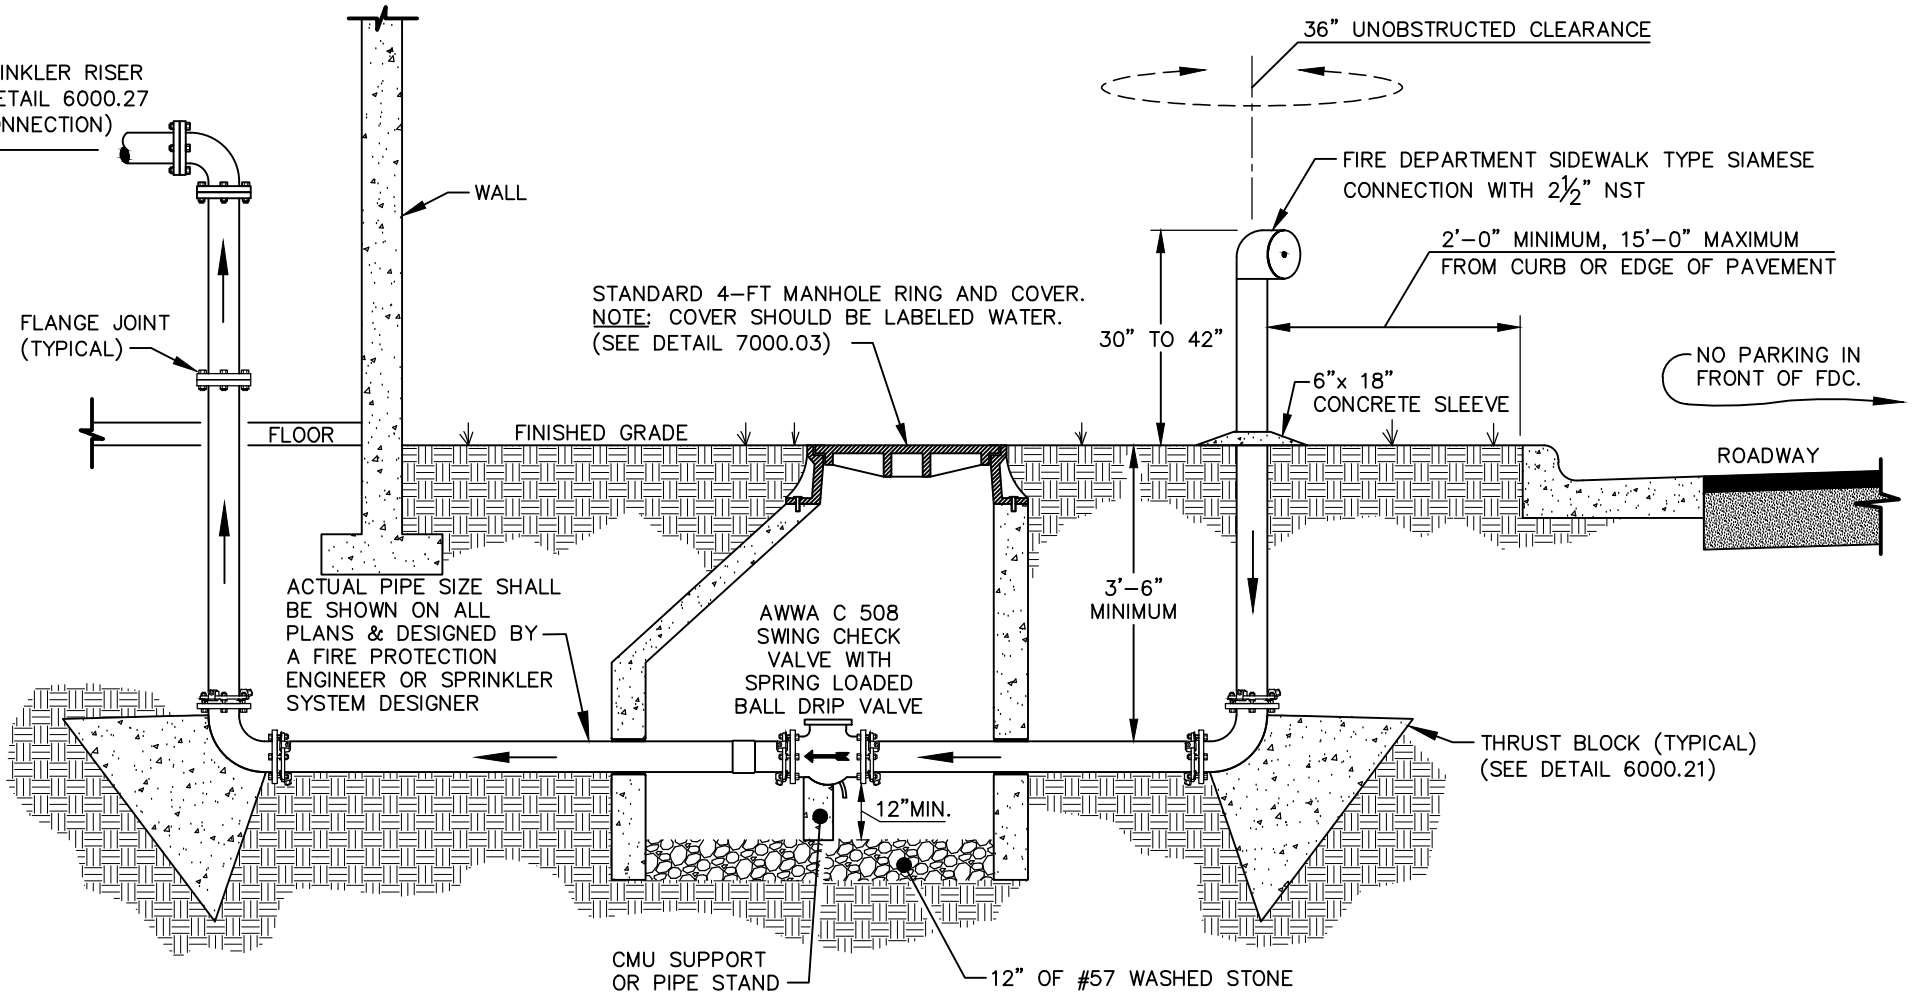

NOTES:

1. SIAMESE CONNECTIONS MUST BE WITHIN 50 FEET OF A FIRE HYDRANT, EXCEPT AT TOWNHOUSES, APARTMENT BUILDINGS, AND WITHIN URBAN SETTINGS.
2. SIAMESE CONNECTION CAN BE ATTACHED TO BUILDING.
3. TWO 3/4 INCH STAINLESS STEEL RODS ON EACH PIPE SEGMENT MAY BE SUBSTITUTED FOR WEDGE ACTION RESTRAINTS.
4. SPRING LOADED BALL DRIP VALVE SHALL BE INSTALLED VERTICALLY IN FRONT OF CHECK VALVE DISC. AN ADDITIONAL FITTING MAY BE REQUIRED SO THAT DRIP VALVE IS VERTICAL.

CURB SIDE FIRE DEPARTMENT CONNECTION

DETAIL No.

6000.28



EFFECTIVE: 07/01/23