




PLAN VIEW

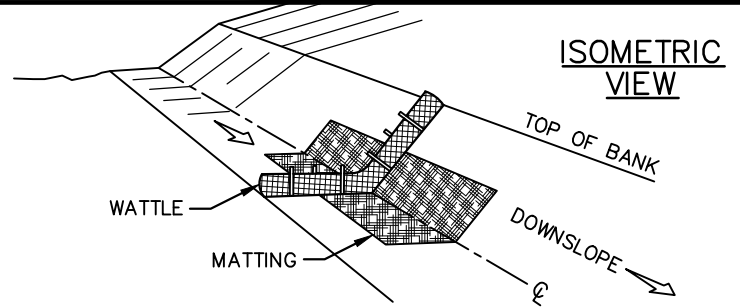

- NOTES:**
1. USE A MINIMUM 12 INCH DIAMETER EXCELSIOR WATTLE.
  2. USE 24 INCH LONG WOODEN STAKES WITH A 2"x2" NOMINAL CROSS SECTION.
  3. INSTALL WATTLE(S) TO A HEIGHT ON SLOPE SO FLOW WILL NOT WASH AROUND WATTLE AND SCOUR SLOPES, OR AS DIRECTED.
  4. INSTALL A MINIMUM OF TWO UPSLOPE STAKES AND FOUR DOWNSLOPE STAKES AT AN ANGLE TO WEDGE WATTLE TO GROUND AT BOTTOM.
  5. PROVIDE STAPLES MADE OF 0.125 INCH DIAMETER STEEL WIRE FORMED INTO A U-SHAPE NOT LESS THAN 12 INCHES IN LENGTH.
  6. INSTALL STAPLES APPROXIMATELY EVERY 1 LINEAR FOOT ON BOTH SIDES OF WATTLE AND AT EACH END TO SECURE IT TO THE SOIL.
  7. AFTER INSTALLATION OF STAPLES, CHINK ANY GAPS BETWEEN WATTLE AND GROUND WITH MATTING.
- MAINTENANCE:**
1. INSPECT WATTLES AT LEAST WEEKLY AND AFTER EACH RAINFALL. MAKE NEEDED REPAIRS OR IF DAMAGED, REPLACE IMMEDIATELY.
  2. CLEAN OUT SEDIMENT ACCUMULATION TO BOTTOM OF WATTLE TO MAINTAIN FLOWS THROUGH THE CHANNEL.
  3. REMOVE ALL TRASH AND OTHER DEBRIS.

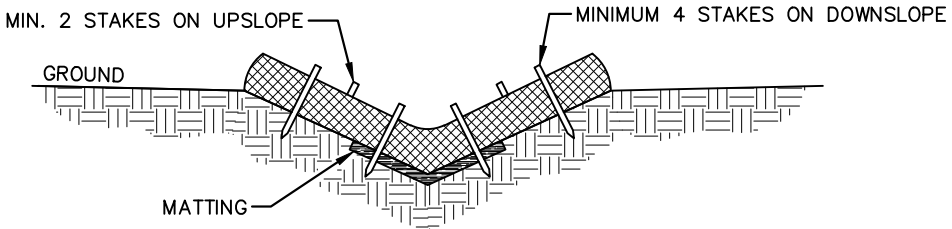



V-DITCH SECTION VIEW

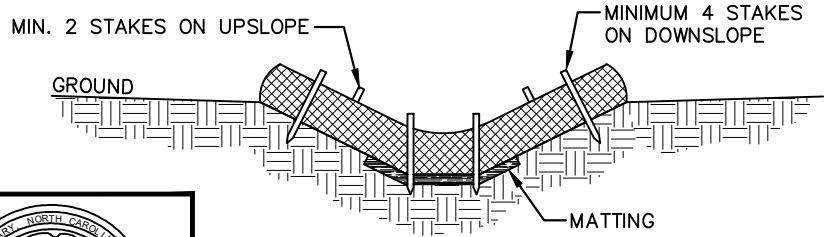


TRAPEZOIDAL DITCH SECTION VIEW

NTS

WEAVE STAPLES THROUGH MESH CASING OF WATTLE

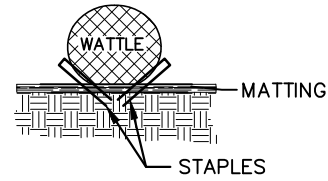

STAPLE INSTALLMENT SECTIONS

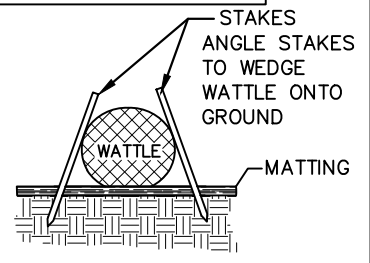

STAKE INSTALLMENT CROSS SECTION



EFFECTIVE: 07/01/24

WATTLE

DETAIL No.

4000.06  
SHEET 2 OF 2