



**PLAN VIEW**

- NOTES:**
1. CLEANOUT SHALL BE PLACED AT RIGHT-OF-WAY OR EDGE OF EASEMENT.
  2. DO NOT INSTALL CLEANOUT INSIDE A FENCE.
  3. CONNECTIONS TO 15 INCH OUTFALLS AND GREATER MUST BE MADE INTO MANHOLE.
  4. MARKING TAPE SHALL BE INSTALLED FOR ALL SERVICE CONNECTIONS FROM THE MAIN LINE TO THE CLEANOUT FOR ALL NEW CONSTRUCTION OR RETROFIT INSTALLATIONS USING OPEN TRENCH METHODS.

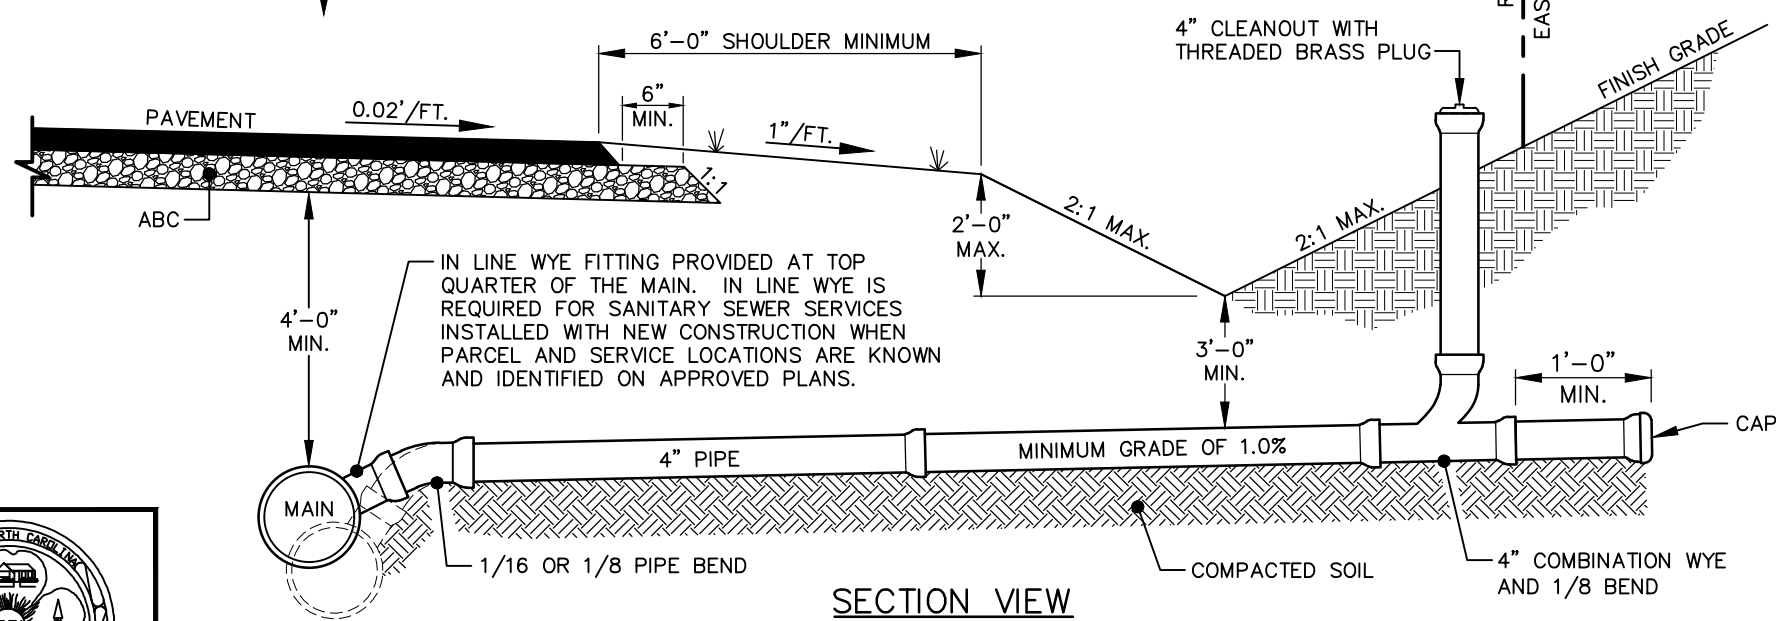

**SECTION VIEW**

**STANDARD 4" SANITARY SEWER SERVICE FOR DITCH SECTION**



EFFECTIVE: 07/01/24

DETAIL No.  
7000.21