


NOTES:

1. PIPE SHALL BE BEDDED IN NO. 57 STONE TO CENTER OF PIPE AND EXTEND 6 INCHES BELOW THE PIPE.
2. FILTER FABRIC SHALL BE PLACED AS SHOWN IN DETAILS BELOW.
3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING COMPACTION REQUIREMENTS BY SOILS TESTING CERTIFIED BY A LICENSED PROFESSIONAL GEOTECHNICAL ENGINEER.
4. NATIVE SOILS SHALL NOT BE USED AS BACKFILL IN THE RIGHT-OF-WAY.



ASPHALT PAVEMENT

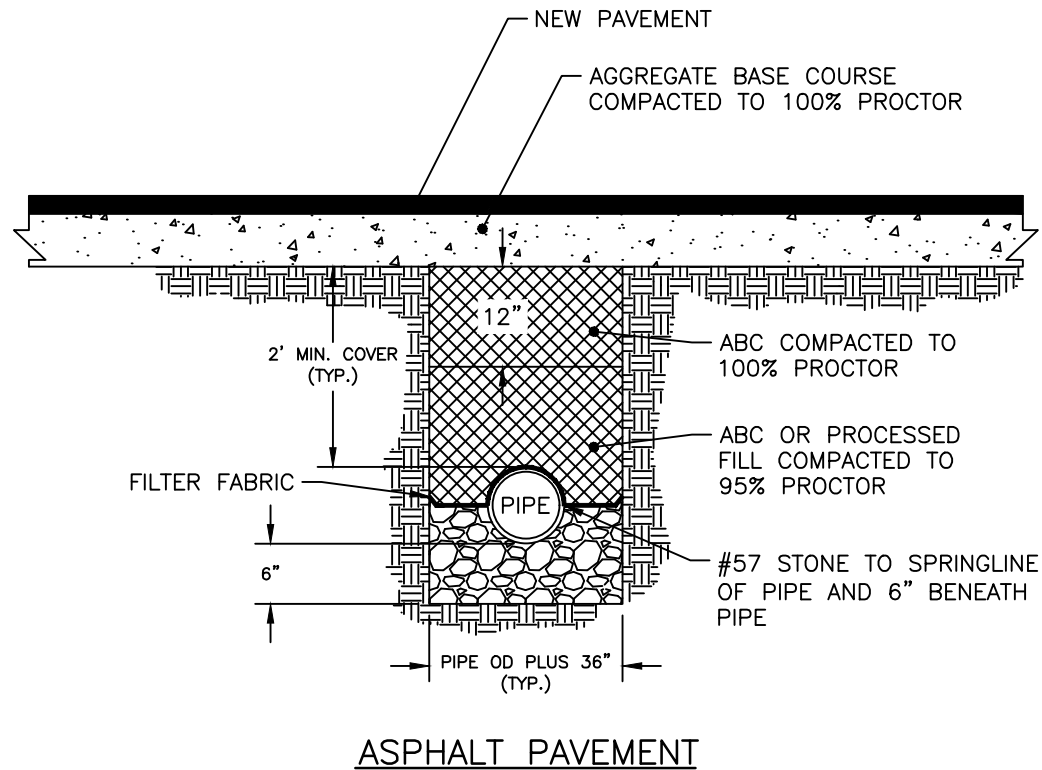

NTS

**NEW DEVELOPMENT ROAD RIGHT-OF-WAY  
STORMWATER TRENCH INSTALLATION**

DETAIL No.

8000.11

EFFECTIVE: 07/01/24