

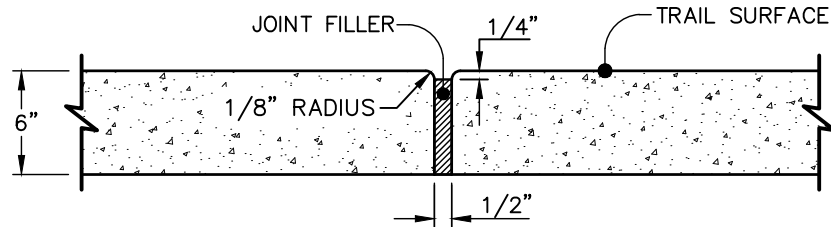


SIDE SLOPES SHALL NOT EXCEED 3:1.
CUT & FILL SLOPES SHALL TIE INTO
EXISTING SLOPES TO CREATE AN EVEN
TRANSITION.

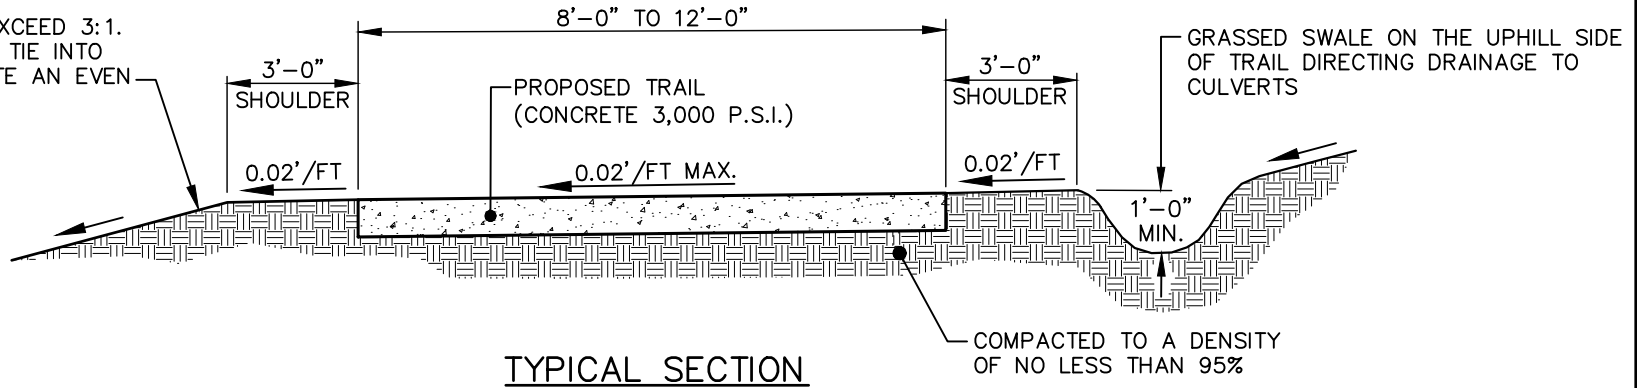

NOTES:

1. **GREENWAY TRAIL SHALL BE CONSTRUCTED AT WIDTH INDICATED ON SITE LAYOUT & GRADING SHEETS.**
2. TRAILS GREATER THAN 10 FEET WIDE SHALL HAVE 2 FOOT WIDE SHOULDERS, UNLESS SPECIFIED OTHERWISE ON THE SITE LAYOUT & GRADING SHEETS.
3. TRANSVERSE EXPANSION JOINTS TO BE A MAXIMUM OF 50 FEET.
4. ALL CONCRETE TO BE FINISHED WITH CURING COMPOUND.
5. A 6 INCH DEPTH IS REQUIRED.
6. SAW CUT JOINTS EVERY 6 FEET OR WIDTH.
7. NO UTILITY SURFACE COVERS/PLATES/MANHOLES SHALL BE LOCATED WITHIN TRAIL AND SHALL BE MINIMUM 2 FEET FROM THE EDGE OF TRAIL.



STANDARD CONCRETE GREENWAY TRAIL

EFFECTIVE:07/01/24

DETAIL No.

9100.04