



CONTROL JOINTS 10-FT ON CENTER,
PERPENDICULAR TO RUN OF WALK;
SAW CUT JOINTS 1/4" WIDE AND 1" DEEP.

1/2" WIDE PRE-FORMED ASPHALTIC
EXPANSION JOINT RECESSED 1/2"
FROM SURFACE AT 30-FT MAXIMUM
ON CENTER SPACING

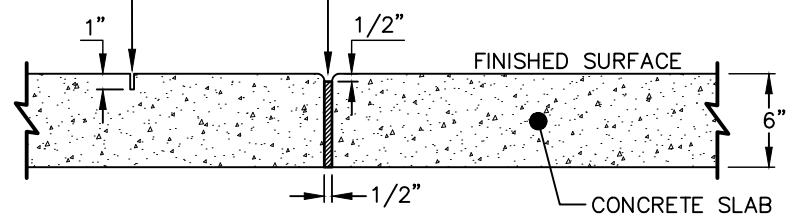

CONCRETE DETAIL

SIDE SLOPES SHALL NOT EXCEED 3-FT OF RUN: 1-FT OF RISE UNLESS
OTHERWISE INDICATED ON GRADING PLANS. CUT & FILL SLOPES SHALL
TIE INTO EXISTING SLOPES TO CREATE AN EVEN TRANSITION.

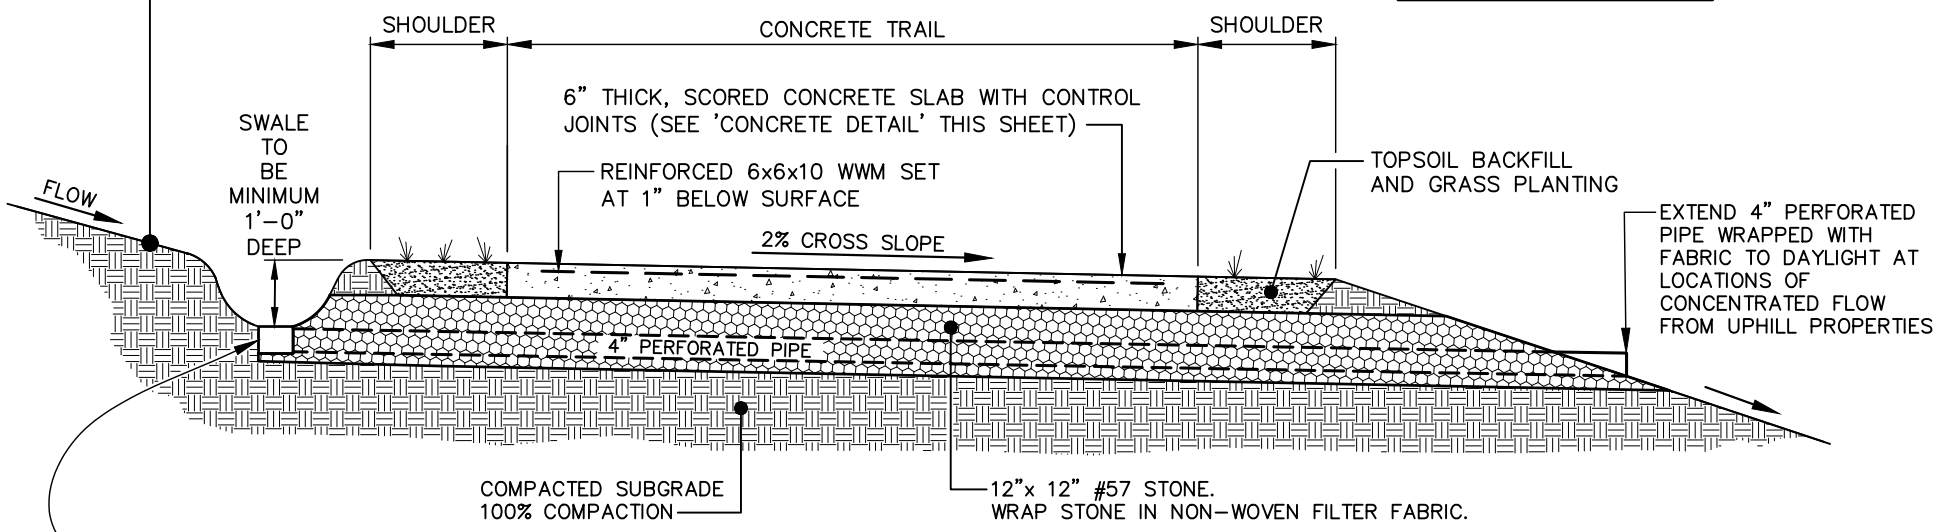

NDS (6^{3/16}" x 5^{7/8}"), OR YARD INLET, OR APPROVED
EQUIVALENT. INSTALL YARD INLETS AT LOCATIONS OF
CONCENTRATED FLOW FROM UPHILL.

- NOTES:**
1. END OF CONCRETE TRAIL SHALL BE FORMED FOR APPROPRIATE MATERIAL TRANSITION.
 2. TRAIL SHALL BE SET ABOVE GRADE WITH A CROSS SLOPE OF 2% AND BACKFILLED TO MEET ADJACENT GRADES.
 3. CONTRACTOR IS TO ENSURE POSITIVE DRAINAGE UNDER CONCRETE TRAIL.



EFFECTIVE:07/01/24

FRENCH DRAIN AND 4" PIPE UNDER CONCRETE TRAIL

DETAIL No.
9600.05