

SECTION 8000
STORM DRAINAGE

TABLE OF CONTENTS

8010 DESIGN

- A. Location
- B. Sizing

8020 MATERIALS

- A. Pipe Materials
- B. Structure Materials
- C. Installation
- D. Inlets and Outlets

8030 EXCAVATION AND PREPARATION

- A. Preparation
- B. Trenching

8040 PIPE LAYING AND BACKFILLING

- A. General Requirements

8050 PAVEMENT REPAIRS

- A. Open Trench Pavement Repair

8060 INSPECTIONS AND TESTING

- A. Video Assessment and Cleaning

8010 DESIGN

A. Location

1. All public and private storm drainage systems shall be installed in right-of-way or easements. Minimum easement widths shall be 20 feet for pipes 12 inches and up to and including 48 inches in diameter, and 30 feet for pipes greater than 48 inches in diameter. For pipes deeper than 10 feet, the easement width shall be specified by Cary staff. Private landscaping and roof drainage pipes less than 12 inches may also require easements based on the depth of the pipe and accessibility as determined by Cary staff.
2. See Sections 6000, 6500, and 7000 for horizontal and vertical separation requirements between storm drainage pipe, water lines, and sanitary sewer lines.
3. Cary shall maintain only the storm drainage systems within Cary maintained right-of-way and on property owned by Cary. All others shall be maintained by the property owner(s).
4. Discharge points shall be a minimum of 10 feet downhill from the building envelope.
5. Structures shall be spaced to intercept flow at the uphill turnout of intersections unless the street design provides a continuous downhill grade around the radius and down the intersecting street.
6. Stormwater grated inlets shall not be placed within travel areas of roadways, driveways, or parking lots including parking spaces.

B. Sizing

1. Systems shall be designed based on rainfall intensities of 4 inches per hour for street inlet spacing, the 2-year storm for side ditches, the 10-year storm for street drainage pipe sizing, the 25-year storm for cross-street drainage, and the 100-year storm for floodplain areas.
2. Curb inlets shall be spaced to provide a maximum spread of 8 feet for the design storm. In areas of heavy pedestrian traffic, the maximum allowable spread may be decreased by applicable Cary official as laid out in Cary ordinances.
3. Runoff rates shall be calculated by the Rational Method (for drainage areas less than 2 square miles), SCS Method (for drainage areas greater

than 2 square miles), or other acceptable procedure. Runoff computations shall be based on rainfall data published by the National Weather Service NOAA Atlas 14 for this area.

4. Time of concentration (t_c) shall be determined using standard acceptable methods and the storm duration shall equal t_c .
5. Pipe shall be sized in accordance with the Manning Equation and applicable nomographs to carry the design flow and to provide a velocity of at least 2 feet per second (fps) during the 2-year storm.
6. Culverts shall be sized in accordance with the Energy Equation and applicable nomographs to carry the design flow and to provide a velocity between 2-10 fps during the 2-year storm.
7. The minimum design slope of a pipe or culvert shall be 0.5 percent.
8. The minimum pipe diameter shall be 12 inches where the inlet is grated and 15 inches where the inlet is not grated. Private landscaping and roof drainage pipes may be less than 12 inches in diameter. Private landscaping and roof drain connections to structures shall be installed per Standard Detail 8000.07 and an encroachment agreement will be required if it's in the public right-of-way.
9. Structures shall be installed at each deflection of line, grade, and/or change in pipe material.
10. No inaccessible storm drainage structures shall be allowed. Open-throat yard inlets shall have a manhole lid incorporated into the concrete lid for accessibility.
11. Drop inlet structures require the ponding elevation of 100-year storm to be calculated and delineated on recorded maps. A building restriction line 2 feet above the 100-year ponding elevation shall also be recorded.
12. The maximum length between access points shall be 400 feet for all pipe sizes.
13. Channels and ditches shall be designed to carry the design flow at nonerosive velocities. Calculations indicating design velocities shall be provided along with typical channel cross-sections. The maximum allowable design velocity in grass channels is 4 fps.
14. A Hydraulic Grade Line (HGL) study shall be performed for all storm drainage systems. The study shall include profiles that show invert slopes, proposed finished grade and hydraulic grade line. Hydraulic grade line shall be required to stay within pipe to ensure no surcharge on system.

8000-3

ASTM Standard C443 (O Ring or Single Offset) flexible watertight sealed pipe shall be used in cases where it is not practicable.

15. Stream crossings will necessitate a backwater study on the 100-year storm.
16. The 100-year backwater shall be delineated on all plans and a backwater easement provided. A building restriction line two feet above the 100-year backwater elevation shall also be delineated on all maps for recording.
17. In cases where more than one pipe is required for a stream crossing, a maximum of three pipes or box culverts consisting of one primary and two overbank conveyances, shall be provided. A two pipe or box culvert crossing with primary and overbank conveyance may be approved with proper justification. Crossing geometry should mimic the natural channel.
18. A pipe and structure table will be required on the plans to include Pipe ID, elevations, size (diameter or height & width), material, shape, pipe classification and joint type.

8020 MATERIALS

A. Pipe Materials

1. Reinforced Concrete Pipe shall conform to ASTM C76, Table III or Table IV. Joints shall be sealed with a plastic cement putty meeting ASTM C990 (preformed flexible sealant).
2. Reinforced Concrete Box Culvert shall conform to ASTM C1433, ASTM C1504, or ASTM C1786. Joints shall be sealed in conformance with ASTM C990 (preformed flexible sealant) and/or C877 (external sealing bands), based on manufacturer's recommendations for the specific application.
3. Aluminized Steel Type 2 Pipe shall be 36 inches in diameter or greater and be bedded and manufactured according to ASTM A 929 (Manufacturing), 760 (Coating), 796 (Structural Design) and 798 (installation).
4. Corrugated Aluminum Pipe shall conform to ASTM B744 and design standard ASTM B790. Installation and backfill shall comply with standards ASTM B788 and AASHTO M145. The corrugated aluminum pipe shall meet or exceed HS20 loading requirements and NCDOT approvals.
5. High Density Polyethylene (HDPE) Corrugated Pipe shall be used only in areas outside of public right-of-way and easements. When used in private locations, pipe material shall be rated on approved plans and include the

8000-4

submission of design criteria. Installation of HDPE pipe shall adhere to design criteria standards. Pipe material shall meet the product specifications of ASTM F2648 and shall have a smooth interior. Pipe joints shall consist of an integral bell and spigot type joint with “O” ring rubber gasket meeting ASTM F477 placed on the spigot end. At least two (2) corrugations of the spigot end must insert in the bell end. Installation shall adhere to the specification of ASTM D2321 and be certified by an engineer. HDPE pipe, 24” or under may be used outside the right-of-way only. A cored hole with manufactured connections (boot/gasket) are required for box or manhole perforations.

6. Polyvinyl Chloride (PVC) Pipe shall be used only in areas outside of public right-of-way and easements. When used in private locations, material pipe shall be rated on approved plans and include the submission of design criteria. Installation of PVC pipe shall adhere to design criteria standards. Pipe material shall meet the product specifications of ASTM F949-93a and shall have a smooth interior. PVC pipe, 24” or under may be used outside the right-of-way only.

B. Structure Materials

All storm drainage structures such as manholes, inlets, junction boxes and catch basins shall be constructed of either solid brick, solid block, or precast concrete.

1. Clay Brick shall be solid, rough, sound clay brick conforming to ASTM C32, Grade MS. The brick shall be laid with full shove joints, filling up the joints with mortar. The thickness of the joints shall not exceed 3/8 of an inch.
2. Concrete Block or brick shall be solid and conform to ASTM C139 as to design and manufacture. The block or brick shall be embedded in a mortar bed to form a 1/2-inch mortar joint.
3. Precast Concrete Manholes shall meet ASTM C478 as to design and manufacture. All manhole cones shall be the eccentric type. Joints shall be sealed with a plastic cement putty meeting Federal Specification SS-S-00210, such as Ram-Nek or a butyl rubber sealant. All external joints shall be wrapped with 6-inch minimum width rubberized mastic joint wrap.
4. Precast Concrete Box Structures shall meet ASTM C913 as to design and manufacture. Joints shall be sealed with a plastic cement putty meeting Federal Specification SS-S-00210, such as Ram-Nek or a butyl rubber sealant. All external joints shall be wrapped with 6-inch minimum width rubberized mastic joint wrap.


5. Manhole Frames and Covers shall be as specified in Section 7000, with “STORM”, “CARY NORTH CAROLINA” and the Cary Seal stamped on the cover and two pickholes and a 1-inch diameter hole.
6. Steps shall meet the material, strength, and installation requirements as specified in Section 7000. The location of steps for storm drainage shall be per Detail 8000.6. Manholes shall have one step at the top and one step at the bottom of the structure in the public right-of-way.
7. Headwalls and Endwalls shall be constructed in accordance with NCDOT details, or precast concrete with wing walls and apron by an approved manufacturer. Installation of precast headwalls and endwalls shall be in accordance with the manufacturer's recommendations. Design shall include provision for relief of hydraulic pressure. Voids shall be filled with non-shrink grouting. Gabion baskets shall not be allowed.
8. Stormwater Control Measure (SCM) outlet structures shall be cast-in-place, precast concrete, or aluminum only.
9. Frame, Grate & Hood shall be cast iron and meet the ASTM requirements set forth in the latest edition of the NCDOT “Standard Specifications for Roads and Structures” and the dimensional requirements set forth in the latest edition of the NCDOT “Roadway Standard Drawings #840.03”. Grate shall be stamped with the NCDOT Specification number as evidence of satisfying the above requirements. Hoods and drop inlet grates shall be stamped “Drains to River”. Lettering shall be $\frac{3}{4}$ ” height and shall be clean, crisp and free of defects.

C. Installation

1. Pipe may enter through the corner of all structure material types except precast concrete "waffle" boxes.
2. A reinforced concrete slab designed by an engineer may be used for oversized structures to adjust an inlet to standard dimensions. They must meet H-20 loading.
3. Pipe shall be installed to provide a true line and grade between structures.
4. The minimum cover for storm drain pipe shall be 2 feet to finished subgrade under roads and 1 foot to finished grade in non-load-bearing areas. A minimum of 3 feet of backfill shall be placed prior to construction equipment or vehicles traversing over any pipe or culvert. Trench excavation and backfilling shall be in accordance with Section 8000 of the Specifications unless more stringent installation requirements are listed with specific material type and certified by an engineer. Storm drain trench

width shall be the pipe OD plus 36-inches per detail drawings 8000.10 and 8000.11.

5. Dam and Stormwater Control Measures' pipe outlet trench through a dam shall not be bedded in stone and at a minimum include an appropriately designed filter diaphragm, full length concrete cradle, or anti-seep collar per detail 8000.12. Natural ground installations through a dam or SCM bedding shall be at the direction of a licensed professional geotechnical engineer.
6. The trench bottom shall provide a firm and uniform support for the pipe. Where bell and spigot type is used, recesses shall be excavated to receive the pipe bell.

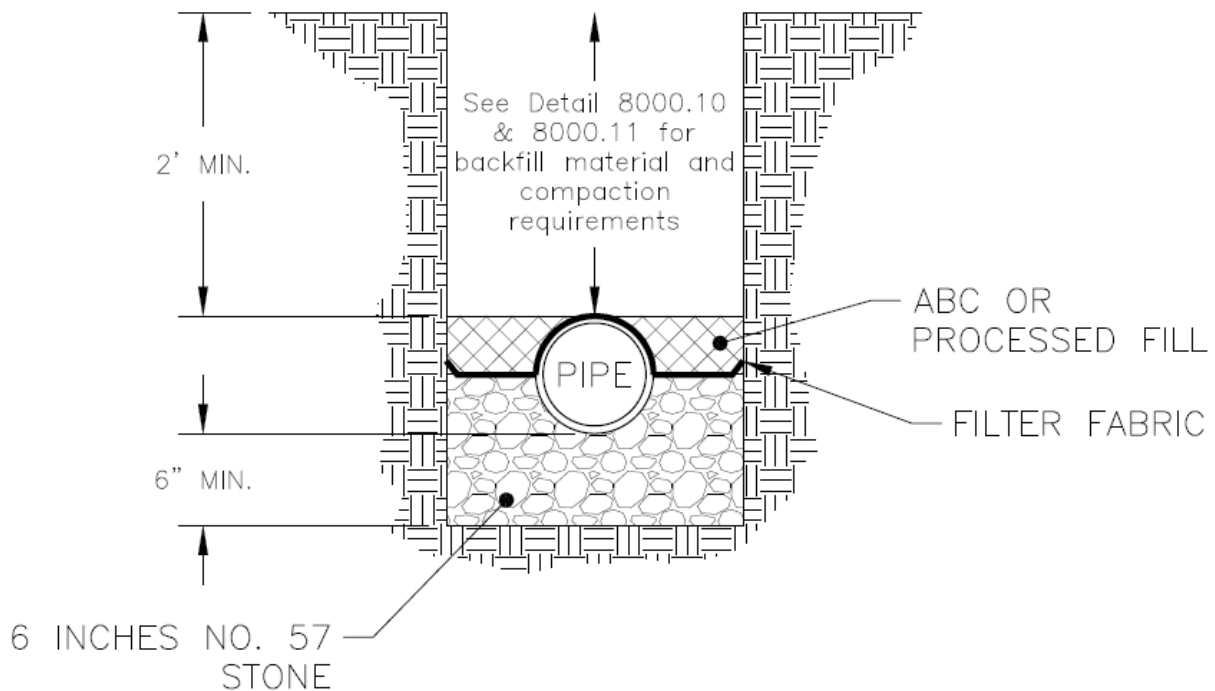

STANDARD STORMWATER INSTALLATION

7. Pipe shall be bedded in No. 57 stone to the center of the pipe and extending a minimum of six inches under the pipe. Filter fabric shall be placed at the interface of the No. 57 stone/top of pipe and the fill material within the pipe trench. Fill material compaction above filter fabric shall meet the compaction requirements outlined in this Section and the Standard Stormwater Trench Installations Detail 8000.10 and the New

Development Road Right-of-Way Stormwater Trench Installation Detail
8000.11.

8. Concrete pipe with lift holes will require the installation of manufacturer provided plugs prior to backfill.
9. In instances where compliance with compaction requirements is questionable as determined by the Inspector, testing shall be provided by the Contractor and a licensed Geotechnical Engineer to verify compliance.
10. The minimum trench width shall be the outside pipe diameter plus 36 inches to allow for proper compaction around the pipe. (18 inches on each side of the pipe).
11. Pipe shall not project into a drainage structure but shall be finished flush with the inside of the structure. Voids shall be filled with non-shrink grouting. The exterior annulus between the box and the pipe shall be filled with non-shrink grout and wrapped with an approved joint seal material.
12. All external manhole or box joints shall be wrapped with an approved joint seal material.
13. Catch basins between 5 and 20 feet in depth shall have minimum interior dimensions of 4 feet by 4 feet, and those over 20 feet in depth shall have minimum interior dimensions of 5 feet by 5 feet.
14. Each drainage structure shall have an invert constructed from concrete and shaped to conform with the pipe ID, and a bench with a maximum 5:1 slope.
15. Precast concrete structures may be installed only to depths certified as acceptable by the manufacturer.
16. Each curb's inlet must be installed such that the front wall is straight and aligned with the curb and gutter.

D. Inlets and Outlets

1. Headwalls, endwalls or flared end sections shall be installed at all discharge points, and inlets where there is not a structure.
2. Flared end sections, headwalls or endwalls shall be installed on single pipe culverts up to and including 60 inches in diameter, and on multiple pipe culverts up to and including 36 inches in diameter.

3. Headwalls and endwalls shall be installed on single pipe culverts greater than 60 inches in diameter, and on multiple pipe culverts greater than 36 inches in diameter.
4. Energy dissipaters shall be installed at all discharge points and shall be properly sized to ensure that stormwater is released at a nonerosive velocity.
5. Filter fabric for drainage shall be installed between dissipation pads and the natural ground.
6. The system shall include scour protection for drainage ways.
7. Weep holes shall be required on all boxes, headwalls and endwalls. Per Standard Detail 8000.01, 8000.02, 8000.03, and 8000.04, all boxes shall have two, 2" cored weep holes on the upslope wall placed just above the poured invert. A sandbag filled with #57 stone shall be installed over the weep hole on the exterior of the box to prevent sediment migration from the backfill.
8. Details and design of headwalls, endwalls and flared end sections shall be in accordance with NCDOT standard detail requirements. These details shall be shown in the plan submissions.
9. Additional information on the impact of stormwater discharge onto adjacent properties may be required by Cary.

8030 EXCAVATION AND PREPARATION

A. PREPARATION

1. General Requirements

- a) Trenching for stormwater pipes and culverts shall be excavated to the required depth to allow the installation of the pipe or culverts along the lines and grades shown on the construction drawings.
- b) Prior to trenching for the construction, the Contractor shall locate all existing utilities within the construction zone. At a minimum, this requires Contractor to contact the NC811 notification center at 811, 1-800-632-4949 or NC811.org and enter a ticket for locates. Where critical Cary water and sewer utilities cannot be located by traditional means, specialized utility locating, such as vacuum excavation or ground penetrating radar (GPR) may be required to locate existing utilities before excavating.

8000-9

- c) In all cases where trenchless methods are planned to cross an existing utility corridor, a SUE (subsurface utility exploration) services firm shall be contracted to verify the depths of existing utilities prior to boring. Where SUE involves survey work, the survey shall be in accordance with the requirements of Section 10050 B., C., D. & E. of these Standard Specifications.
- d) The Contractor shall be responsible for implementing all required safety provisions for trenching in compliance with the Occupational Safety and Health Administration (OSHA) regulations and all other applicable safety requirements and procedures.

B. TRENCHING

1. Trench Dimensions

- a) The minimum trench width at the top of the pipe shall be at least 36-inches greater than the outside diameter of the pipe. Rock shall be removed to a depth of at least 6-inches below the bottom of the pipe and the trench backfilled per Standard Detail 8000.10 or 8000.11.
- b) Open trenches shall not exceed 100-feet.
- c) All trenches shall be confined to the limits of the Right-of-Way or drainage easement. Trenches in paved areas shall not be sloped.
- d) All trenches in or along roadways shall be properly backfilled or covered with steel plates meeting H20 loading at the end of each working day. Steel plates shall be secured to ensure they do not move due to vehicular traffic.

2. Trench Protection

- a) Severely unstable trench bottoms requiring undercut excavation shall receive a foundation support system for the pipe designed by a registered Geotechnical Engineer licensed in the State of NC.
- b) A space shall be excavated at each bell to provide ample space to join the pipes with no misalignment.
- c) The Contractor shall take all necessary measures to prevent water from entering the trench.

8040 PIPE LAYING AND BACKFILLING

A. GENERAL REQUIREMENTS

1. Pipe Laying

- a) Open ends of pipes & culverts shall be plugged when pipe laying is not in progress to prevent trench water, soil, and debris from entering.
- b) All pipes & culverts shall be laid in accordance with the manufacturer's recommendations and all applicable Cary Standards, Specifications and Details.
- c) Pipe & culvert laying shall be accomplished in a manner and with the required resources to provide a properly aligned and sealed pipe, culverts, and joints.
- d) All pipes and culverts shall be installed beginning with the downhill section at the lowest elevation, and advanced upslope. All bell ends shall be oriented facing in the uphill direction.

2. Backfill

- a) Per Standard Detail 8000.10, backfill material in Natural Ground applications shall be free from construction material, frozen material, organic material, or unstable material. Backfill with a high clay content or high shrink-swell potential that cannot meet compaction requirements shall be deemed unsuitable and replaced as directed by a professionally licensed Geotechnical engineer. In all other applications, backfill material shall be Aggregate Base Course (ABC) or processed fill in accordance with Details 8000.10 and 8000.11.
- b) Backfill materials that have been allowed to become saturated or with moisture contents non-conducive to meeting compaction requirements shall be deemed unsuitable and replaced.
- c) When original excavated materials have been deemed unsuitable for Natural Ground applications, granular material must be imported to the site to backfill trenches and meet compaction requirements. The following materials shall be acceptable forms of granular backfill: aggregate base course, soil type base course, select backfill material, sand or screenings in accordance with NCDOT Specifications.
- d) In all open trenches, backfill shall be compacted to maximum dry density depicted on Details 8000.10 & 8000.11 as measured by AASHTO method T99. The Contractor shall be responsible for

8000-11

verifying that compaction requirements have been met or exceeded by providing soils testing data from an approved Geotechnical Firm. The soil test results shall be certified by a licensed Geotechnical Engineer.

- e) Backfill for trenches shall be placed in 8-inch lifts or less of uncompacted soil and compacted with a mechanical tamp before placing additional layers.

8050 PAVEMENT REPAIRS

A. OPEN TRENCH PAVEMENT REPAIR

1. General Requirements

- a) All pavement cuts shall be repaired within a maximum of three (3) days from the date the cut is made. If conditions do not permit a permanent repair within the given time limit, permission to make a temporary repair must be obtained from the Infrastructure Field Technician.
- b) Pavement repairs shall be made in accordance with Cary Standard Details.
- c) All asphalt pavement utilized to repair open trenches shall comply with all applicable Cary asphalt pavement material and installation Specifications.
- d) All pavement patches shall be provided in such a manner that a uniform and smooth driving surface free of depressions and/or bumps is obtained. Pavement patches not meeting this standard shall be milled and replaced.

8060 INSPECTION AND TESTING

The Contractor shall furnish all materials, labor, and equipment to perform CCTV inspections of storm drainage system and provide to the Town and Engineer of Record for review.

A. Video Assessment and Cleaning

- 1. As a final measure required for acceptance, the Contractor shall clean and televise all newly installed storm drain systems at the end of site construction to include all pipe both public and private and associated structures. The Contractor shall televise all the junction boxes and storm drains 12-inch and larger installed from the upstream to downstream

junction box with no reverse setups or cutaways. Throughout shooting, the camera shall be panned and tilted for a complete view of the junction box and storm drain at each joint. Additionally, any pipe defects or damage shall be videoed appropriately to assess potential repair. Lighting shall be adequate to view the entire storm drain system from beginning to end. Video inspection shall be conducted only during dry conditions.

2. All CCTV inspections shall be submitted in accordance with the National Association of Sewer Service Companies (NASSCO), version 6 Pipeline Assessment Certification Program (PACP) and Manhole Assessment Certification Program (MACP). All structure defects, operation and maintenance features, construction features, and other miscellaneous features shall be called out in the video and coded in a separate report for each pipe.
3. The video inspection shall be submitted to the Stormwater Field Services Administrator and the Engineer of Record on a Cary approved storage device and formatted with software compatible and readable by Cary. Cary shall not be responsible for purchasing additional software necessary to view the storage devices.
4. The camera shall be advanced at a uniform rate not to exceed 30 feet per minute with a traditional camera or 70 feet per minute if using a 360-degree camera that allows a full and thorough inspection of the new storm drain. The camera shall be a digital, color, pan and tilt high resolution camera capable of producing a 650-line resolution picture. Lighting for the camera shall be white LED lights sufficient to yield a clear picture of the entire periphery of the pipe and all structures (ex: box, manhole). The picture quality shall be acceptable and sufficient to allow a complete inspection with no lapses in coverage. The length of the storm drain shall be measured and recorded on the video screen. The distance counter shall be calibrated before shooting the inspection video.
5. The Contractor shall clean the storm drain system ahead of video inspection with a high-velocity water jet. The video inspection shall take place the same day as cleaning operations unless otherwise approved by the Town Inspector. All construction debris shall be collected in the downstream junction box and shall not be released into any stormwater control measure or outfall.
6. All traditional inspection video files shall be submitted as .mp4 (Video compression codec shall be H.264). All 360 inspection files shall be submitted as .ipf.

7. Prior to submitting the storage devices to the Stormwater Field Services Administrator and Engineer of Record for their review, the Contractor shall label the submittal with the following information:
 - Name of the Project/Development including Cary site plan number
 - Name and contact information of responsible party.
 - Date of televising.
 - Box/Pipe identification as shown on GIS if assigned at the time of CCTV; Else, the Structure ID taken from the design plans.
8. The As-built/Record Drawing, including Engineer's Certification shall reflect any repairs made to stormwater pipes, culverts, and structures.
9. A post-repair CCTV shall be conducted and submitted to the Town and Engineer of Record as outlined above. A report with a description of the repairs made to each identified issue shall accompany the post-repair CCTV.

END OF SECTION 8000