


STAINLESS STEEL SUPPORT HANGER
REQUIRED IF OUTLET PIPING OF TEE
ASSEMBLY EXTENDS GREATER THAN 12"
FROM THE INTERCEPTOR/SEPARATOR'S
INTERIOR WALL

FLOW TO
SAMPLE BOX/SANITARY SEWER

OUTLET SANITARY TEE FOR USE IN 500 GALLON AND GREATER PRECAST
CONCRETE GREASE INTERCEPTORS AND OIL/WATER SEPARATORS. THE
OUTLET SANITARY TEE MAY ALSO BE REQUIRED ON SMALLER GREASE
INTERCEPTORS AND OIL/WATER SEPARATORS BASED ON THE DESIGN OF THE
UNIT.

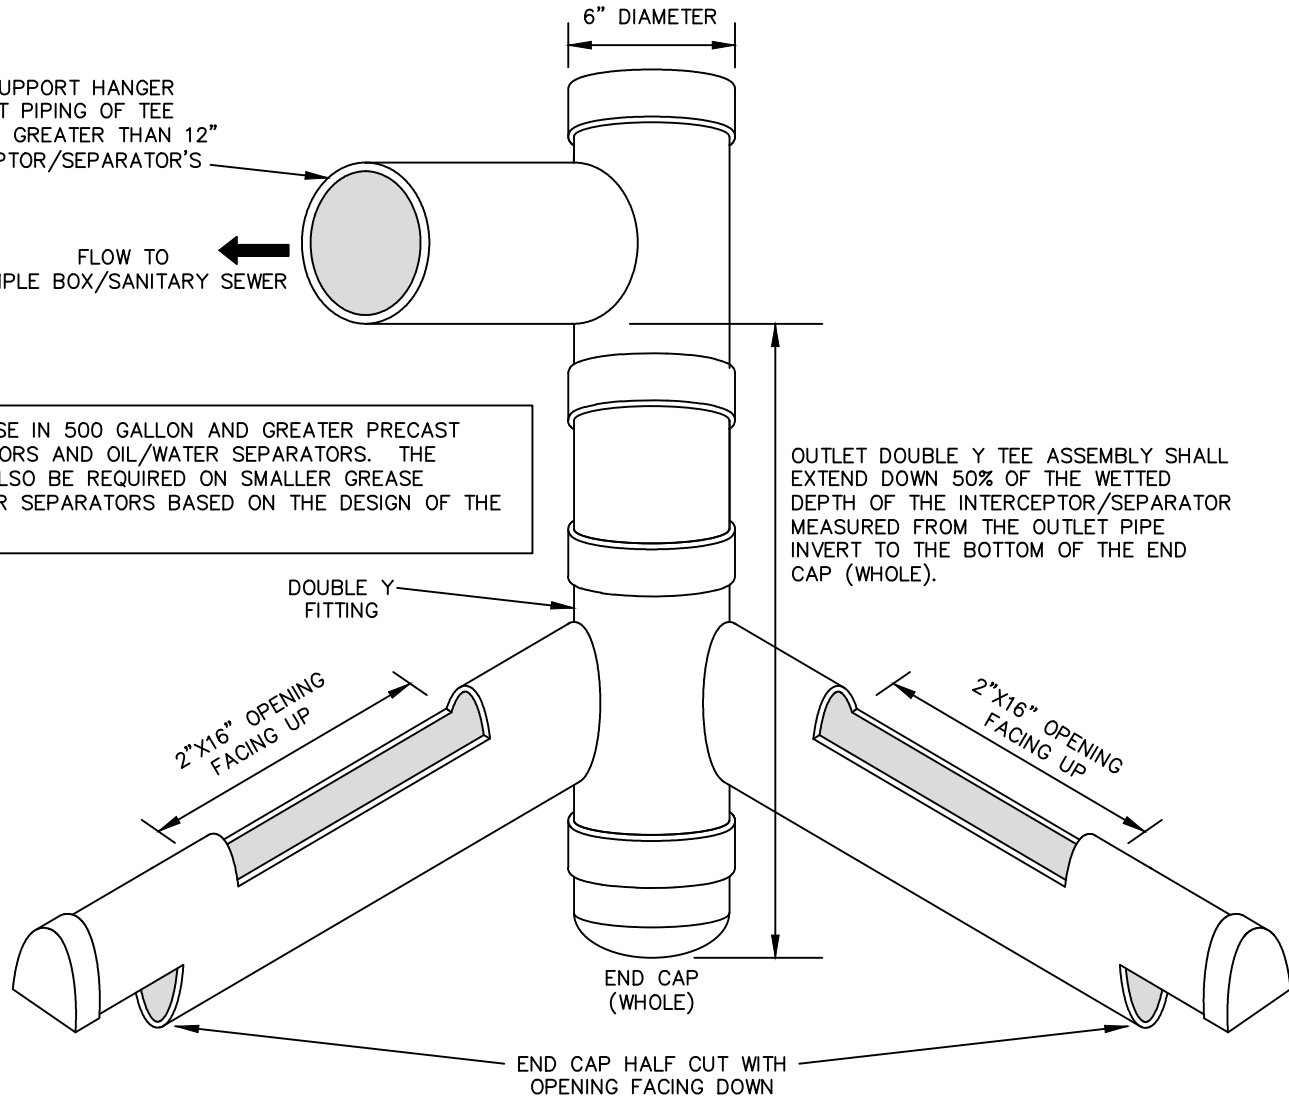

OUTLET DOUBLE Y TEE ASSEMBLY SHALL
EXTEND DOWN 50% OF THE WETTED
DEPTH OF THE INTERCEPTOR/SEPARATOR
MEASURED FROM THE OUTLET PIPE
INVERT TO THE BOTTOM OF THE END
CAP (WHOLE).

NOTE:

TEE ASSEMBLY SHALL BE 6" IN DIAMETER EXCEPT WHEN USED IN CONJUNCTION WITH A
CARY APPROVED SAMPLE VAULT WHERE A 4" DIAMETER ASSEMBLY MAY BE USED.