

Town of Cary Pump Station Inspection Sheet



Facility Name: Park at West Lake

Inspection Date: 9/9/2011

ID Number: 032

Drawdown Date: 5/23/2011

Pump

Condition: Good

Type: Submersible

Pump One: 131 gpm

Discharge Diameter: 6"

Pump Two: 125 gpm

Control: Float / FVNR Starter

Firm Capacity 125 gpm

Manufacturer: ABS

Rep: HD Supply

Model: AFPK1049.5 M75/4EX

919-245-5070

203-238-2700

Wetwell: 6' Diameter

5' Deep

Vol: 1,100 gal

Generator:

Station is powered from South Cary WRF


Comments:

- pump station is like new.
- wetwell and grinder manhole coatings look good
- valve vault is in great condition (some groundwater though)
- has a grinder
- rust on pump guide bracket

Town of Cary Pump Station Inspection Sheet



Park at West Lake PS Pump Curves:

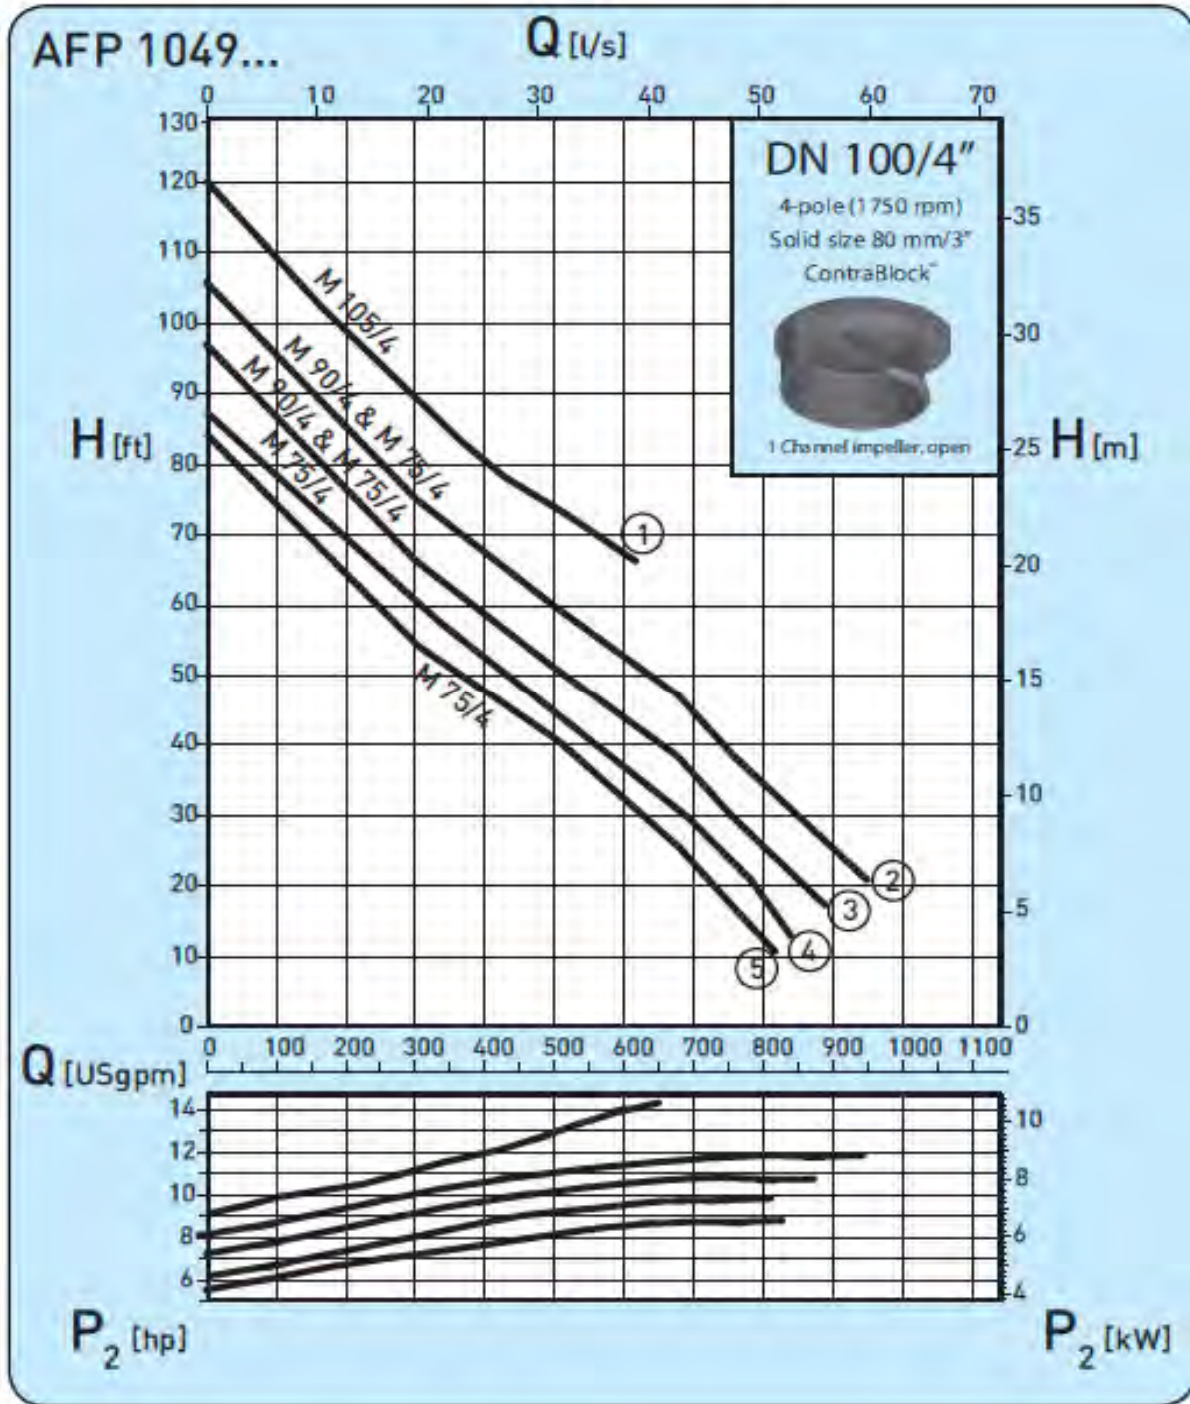

Town of Cary Pump Station Inspection Sheet



Park at West Lake Pump Station



Control Panel



Valve Vault



Control Panel



Hose



Wetwell



Town of Cary Pump Station Inspection Sheet



Grinder



Grinder Hydraulic Unit



Wetwell



Rust on Pump Guide Bracket



Park at West Lake Pump Station



Dailer

